




A TYPICAL TREE PIT DETAIL A: Trees within paved surface
Scale: 1:50
Design referenced from specification GBU 1007 by GreenBlue Urban

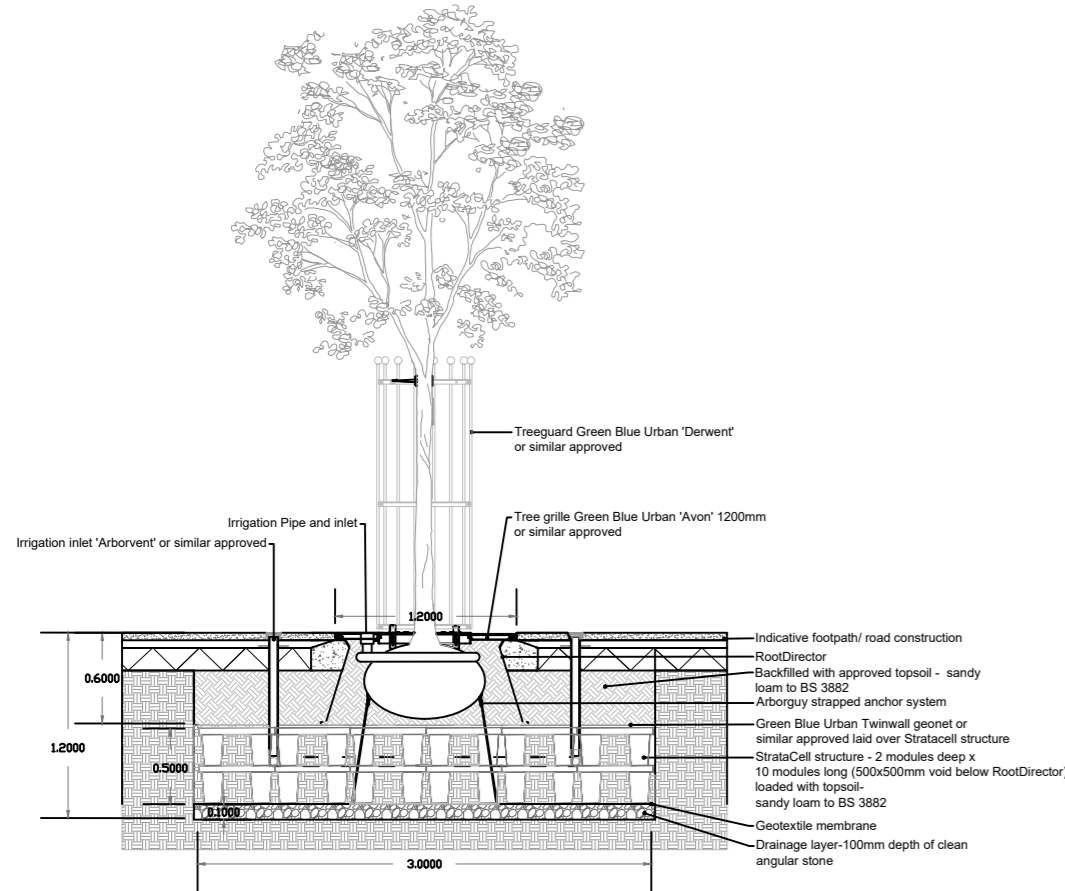


B TYPICAL TREE PIT DETAIL B: Soft verge tree pit detail adjacent to highway/road and in close proximity to garden wall
Scale: 1:50
Design referenced from GreenBlue Urban

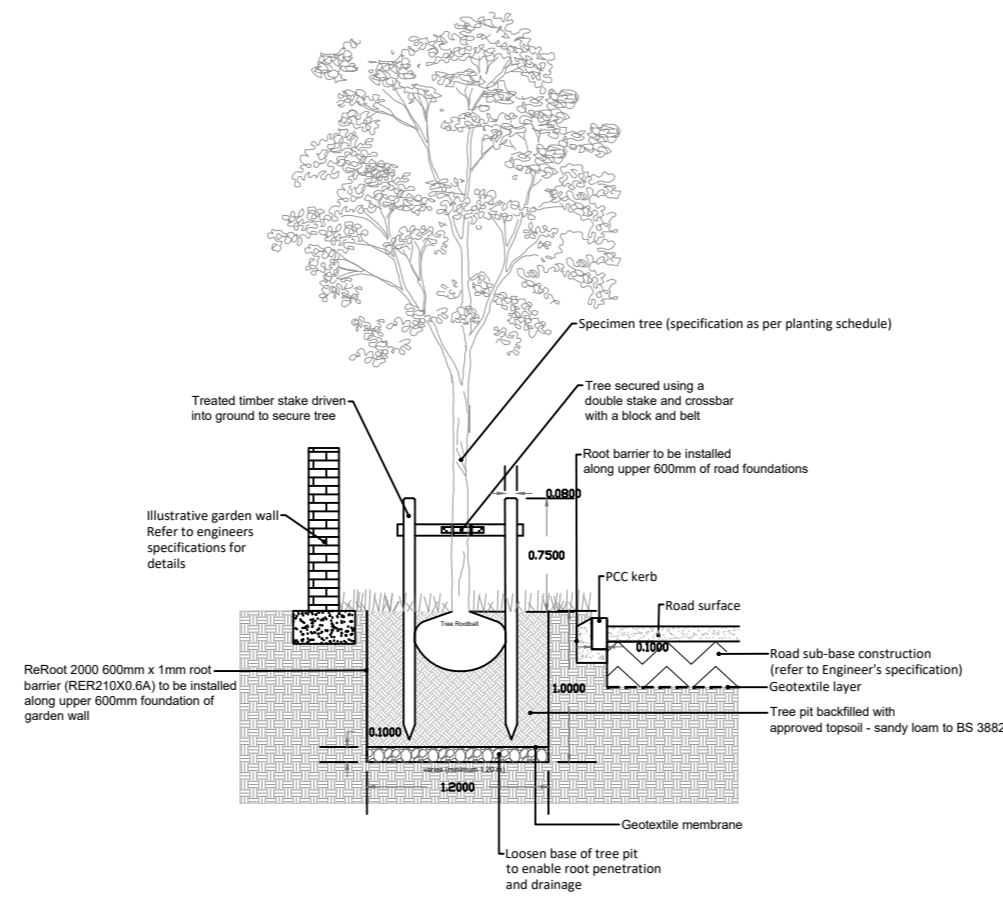


C TYPICAL TREE PIT DETAIL C: soft verge tree pit detail adjacent to highway & footpath
Scale: 1:50 @ A0
Design referenced from GreenBlue Urban

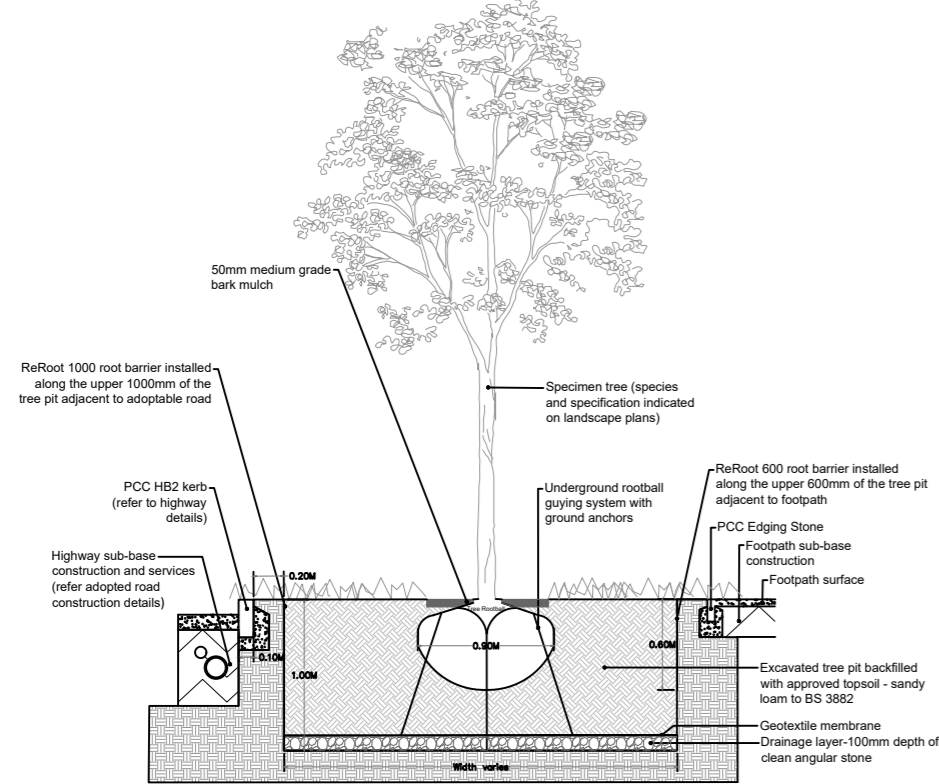

E TYPICAL TREE PIT DETAIL E: trees within soft landscape
Scale: 1:50 @ A0

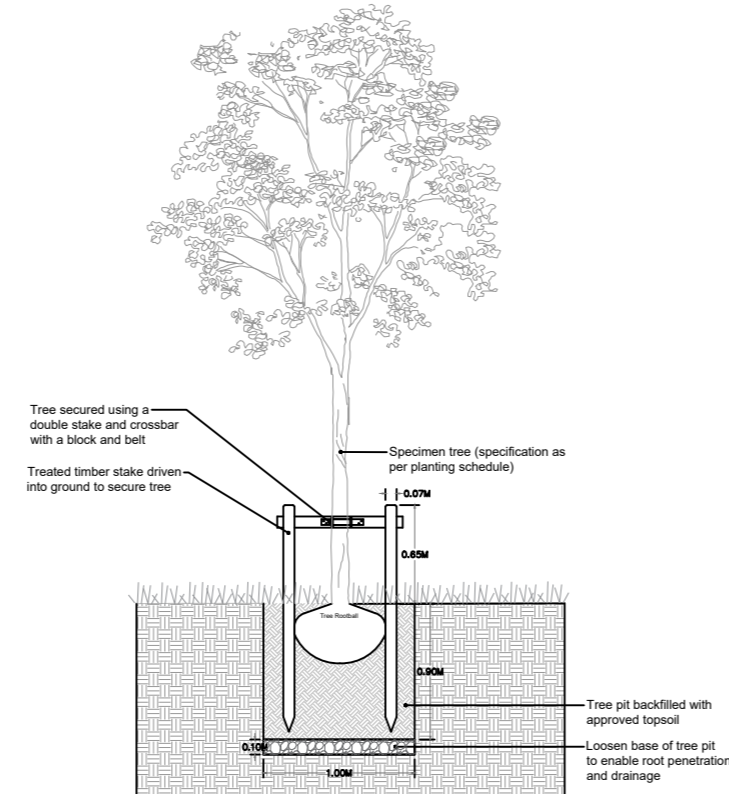

TYPICAL TREE PIT DETAIL: Soft verge tree pit detail adjacent to swale
Scale: 1:50

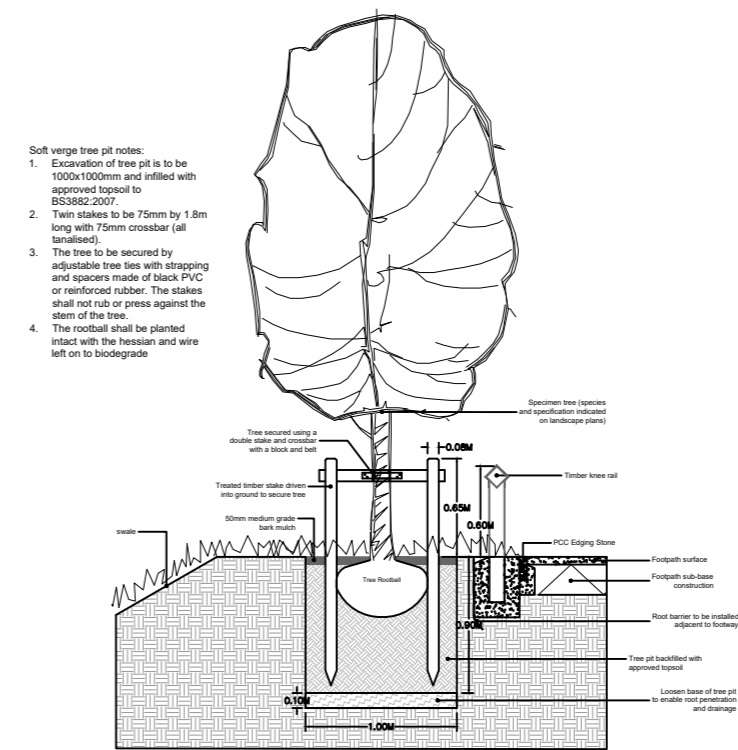

- Soft verge tree pit notes:
- Excavation of tree pit is to be 1000x1000mm and infilled with approved topsoil to BS3882:2007.
 - Twin stakes to be 75mm by 1.8m long with 75mm crossbar (all tanalised).
 - The tree to be secured by adjustable tree ties with strapping and spacers made of black PVC or reinforced rubber. The stakes shall not rub or press against the stem of the tree.
 - The rootball shall be planted intact with the hessian and wire left on to biodegrade.

© this drawing and the building works depicted are the copyright of IDP and may not be reproduced or amended except by written permission. no liability will be accepted for amendments made by other persons.
all dimensions to be checked on site and landscape architect notified of any discrepancies prior to commencement.
do not scale.

- NOTES:
- Do not scale from drawing, use figured dimensions only
 - This drawing to be read in conjunction with all other IDPL drawings and specifications
 - Information shown on these drawings is not valid for Construction. Please refer to the status of the drawing in the Title and Issue box
 - Do not procure or manufacture materials, or undertake construction site works from this drawing unless the issue status is noted as 'for construction'.
 - Any contractor that chooses to take forward this information for construction without full review process and sign-off does so at their own risk.
 - All measurements are to be checked on site prior to construction.
 - Where any conflict or inconsistency occurs between drawing and specification information the Contractor is to immediately notify IDPL prior to continuing working.
 - Information to be read in coordination with Structural Engineer & MSE Engineer drawings & spec; Where any conflict or inconsistency occurs between IDPL and Engineers drawing and specification information the Contractor is to immediately notify IDPL prior to continuing working.

- Tree pit notes:
- Excavation of tree pit is to be 1000x1000mm and infilled with approved topsoil to BS3882:2007.
 - Twin stakes to be 75mm by 1.8m long with 75mm crossbar (all tanalised).
 - The tree to be secured by adjustable tree ties with strapping and spacers made of black PVC or reinforced rubber. The stakes shall not rub or press against the stem of the tree.
 - The rootball shall be planted intact with the hessian and wire left on to biodegrade.